



NOTES

1. The culvert ends shall be beveled to match the embankment or ditch slope, without exceeding the limits shown on this plan.
2. Field cut of culvert ends is permitted, when approved by the Engineer. All field cut culvert pipe shall be treated with treatment as shown in the Standard Specifications or General Special Provisions.


End section length shall be at least six times the diameter of the pipe

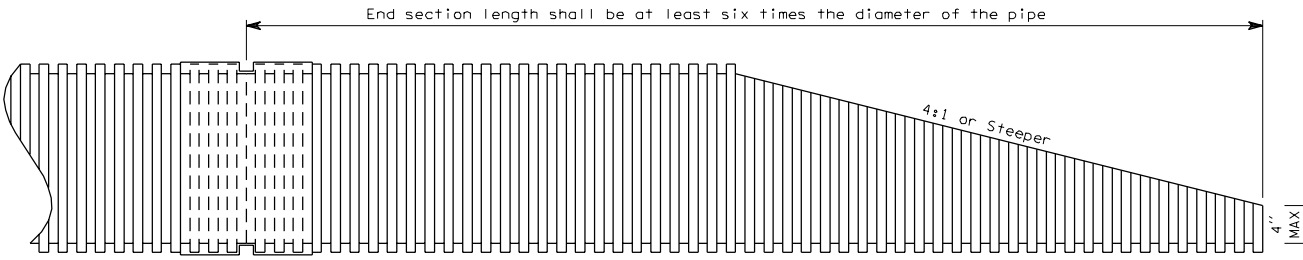

THERMOPLASTIC PIPE

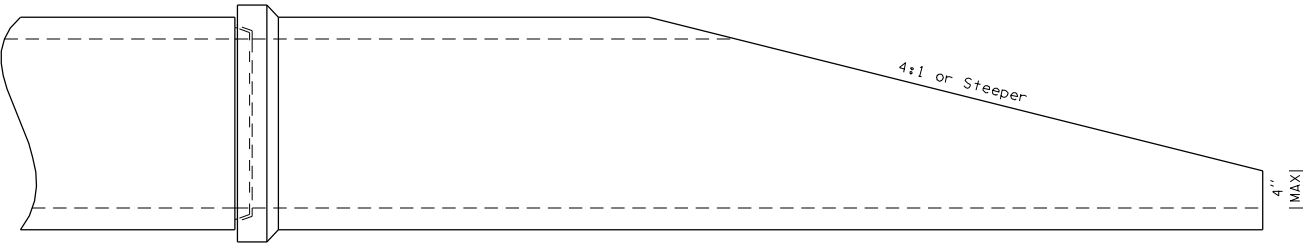

CONCRETE PIPE

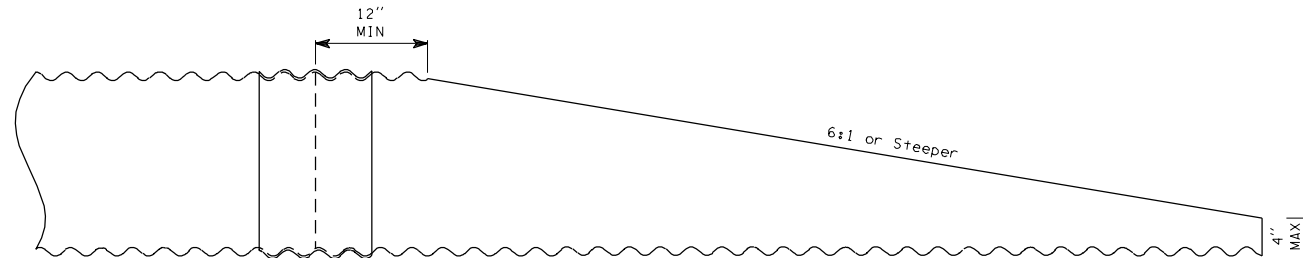

METAL PIPE

BEVELED END SECTIONS